

Technical Service Bulletin

October 2018 TSB331.04

HYDRAcap[®] MAX Storage Procedure

This Technical Service Bulletin provides information required to store HYDRAcap[®] MAX modules as spares or in-situ after they have been placed in service.

Introduction

HYDRAcap[®] MAX modules are stored in a 30% w/v calcium chloride (CaCl₂) to prevent biological growth.



CAUTION: WEAR PERSONAL PROTECTIVE EQUIPMENT WHEN HANDLING CALCIUM CHLORIDE. CaCl₂ CAN CAUSE SKIN AND EYE IRRITATION. 30% CALCIUM CHLORIDE IS ALSO CORROSIVE TO METALS. RINSE ANY SOLUTION OFF METALS .

Storage of New Modules as Spares

New HYDRAcap[®] MAX modules can be safely stored for up to 2 years provided that the following guidelines are met:

- The modules are stored horizontally with filtrate ports facing up.
- The modules are protected from direct sunlight and stored in a cool, dry place between 0-40°C
- The calcium chloride solution is changed based on the table below:

Table 1: Storage solution replacement time

Ambient Temperature (°C)	
2-30	Change solution every 24 months
2-35	Change solution every 18 months
2-45	Change solution every 12 months

- If the solution needs to be changed, follow the procedure below:

1. Remove the caps on all four side ports.



Figure 1: HYDRAcap MAX end port caps and plugs.

2. Drain old preservative from the module, approximately 1.5 – 2.5 liters depending on the module size.
3. Place caps on all ports, but leaving the upper filtrate port open.
4. Through the upper filtrate port of the module, introduce the 30% w/v CaCl_2 solution.
 - a. HYDRAcap MAX 40 – 1500 ml \pm 50 ml of solution
 - b. HYDRAcap MAX 60 – 2000 ml \pm 50 ml of solution
 - c. HYDRAcap MAX 80 – 2500 ml \pm 50 ml of solution

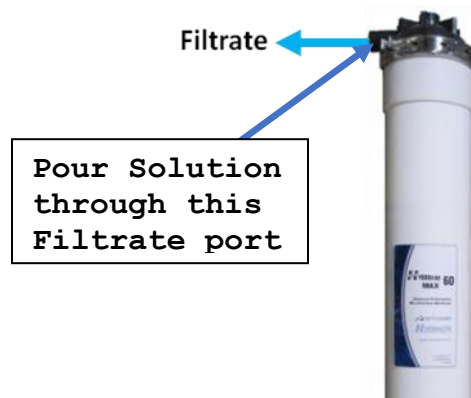


Figure 2: HYDRAcap Max upper half of the module showing filtrate port and where to pour in preservative.

5. Place the last cap on the upper filtrate port to maintain cleanliness, prevent evaporation, and reduce neutralization of CaCl_2 storage solution.
6. For storage, place the modules horizontally with the filtrate ports facing up.

Storage in-situ

HYDRAcap® MAX module(s) that will be stored on the racks should follow the procedures below:

1. If the modules have been used, conduct an MC1 (maintenance clean with chlorine) and continue to step 3.

2. If the modules have not been used, ensure the preservative has been flushed from the system by following TSB 332. Then, continue on to step 3 once the preservatives have been flushed.
3. If the modules will be stored for less than a 48 hour period, pump HYDRAcap® MAX filtrate quality water [i.e. from the Recovery Clean (RC) tank or filtrate break tank] or better (i.e. RO water) to the module(s) to ensure fibers do not dry out.
4. Isolate the module(s) to ensure the filtrate water does not drain from the system.
5. If the module(s) are stored on the rack for more than 48 hours and up to 1 month, it is recommended to pump at least a 25 ppm sodium hypochlorite solution into the modules. Higher chlorine concentrations may be necessary for some systems. In either case, ensure there is a residual free chlorine of at least 0.5 ppm in the module throughout the 1 month or less period. The table below shows the various solutions needed for different storage times. It is required to change out this sodium hypochlorite solution at least once per month if calcium chloride (see step 6) is not used.
6. If the modules are stored for more than 1 month, preserve the system with a 30% calcium chloride solution.
7. To restart the system, an MC1 needs to be conducted for modules that have been preserved with sodium hypochlorite (not necessary for systems stored for less than 48 hr).



CAUTION: 30% CALCIUM CHLORIDE IS ALSO CORROSIVE TO METALS. RINSE ANY SOLUTION OFF METALS .

Table 2: Solution required for various storage times.

Storage Time	Solution
Up to 48 hours	HYDRAcap® MAX filtrate quality water or better
Up to 1 month	25 ppm sodium hypochlorite and check residual chlorine is at least 0.5 ppm
> 1 month	30% w/v Calcium Chloride

If the user prefers to store the modules off the rack, follow the procedures below:

1. Conduct an MC1 (maintenance clean with chlorine).
2. Ensure the modules are thoroughly rinsed with fresh HYDRAcap® MAX filtrate and free from any residual chlorine.
3. Remove the module(s) from the rack.
4. Drain all excess water from the module.
5. Cap all the ports leaving the top filtrate port open.

6. Through the upper filtrate port of the module, introduce the 30% w/v CaCl₂ solution.
 - a. HYDRAcap MAX 40 – 1500 ml ± 50 ml of solution
 - b. HYDRAcap MAX 60 – 2000 ml ± 50 ml of solution
 - c. HYDRAcap MAX 80 – 2500 ml ± 50 ml of solution
7. Replace the last filtrate port cap to maintain cleanliness, prevent evaporation, and reduce neutralization of CaCl₂ storage solution.
8. Place the modules horizontally with the filtrate ports facing up.

Hydranautics
401 Jones Rd.
Oceanside, CA 92058
Tel: (760) 901-2500
Fax: (760) 901-2578
email: info@hy-nitto.com